

Surge protective device
Svodič přepětí
Zvodič prepätia
Ogranicznik przepięć
Dispozitiv de protecție la supratensiune
Überspannungsableiter
Parafoudres
Ограничитель перенапряжений
Арестор (Катодни отводители)
Prenaponska zaštitna jedinica
Viršįtampių ribotuvas
Пристрій захисту від перенапруги
Scaricatore di protezione
Protector de sobretensión

NOARK

Mounting instruction

Montážní návod

Montážny návod

Instrukcja montażu

Instruțiuni de asamblare

Montageanweisung

Instructions de montage

Инструкция по монтажу

Monteringsanvisning

Istruzioni di montaggio

Instrucciones de montaje

Összeszerelési útmutató

Asennusohjeita

Montage-instructies

Instruções de montagem

Navodila za montažo

Οδηγίες Εγκατάστασης

Инструкции за инсталиране

Monteringsvejledningen

Montažu upute

Montavimo instrukcijos

Instalēšanas instrukcijas

Uputstvo za montažu

Paigaldusjuhendid

Інструкція з монтажу

Caution: Installation by electricians only

Varování: Montáž pouze osobou s elektrotechnickou kvalifikací

Varovanie: Montáž smie vykonávať iba osoba s elektrotechnickou kvalifikáciou

Uwaga: Montaż tylko przez uprawnionych instalatorów

Atentie: Instalare numai de catre electricieni

Vorsicht: Montagenur durch Elektrofachkräfte

Attention: Montage uniquement par un électricien

Осторожно: Установка данного оборудования производится только специалистом – электриком

Attenzione: L'installazione deve essere eseguita solamente da personale qualificato

Atención: Este dispositivo debe ser manipulado únicamente por personal cualificado

Figyelem: Szerelést kizárólag szakember végezheti

Внимание: Монтаж само от ел.специалисти












Dėmesio: montavimo darbus gali atlikti tik kvalifikuotas specialistas-elektrikas



Upozorenje: Montažu izvodi samo stručno lice

Обережно: монтаж виконує виключно електрик



Ex9UEP 20 1P 600
Ex9UEP 20R 1P 600Ex9UEP 20 2P 600
Ex9UEP 20R 2P 600Ex9UEP 20 2P 1200
Ex9UEP 20R 2P 1200

mm

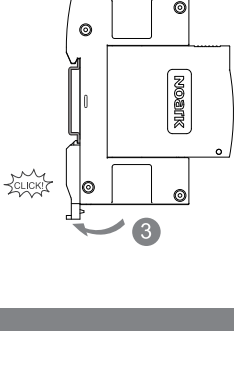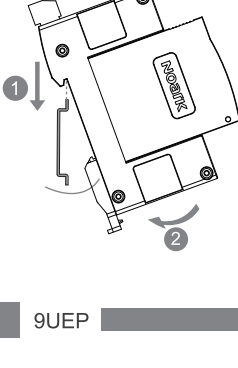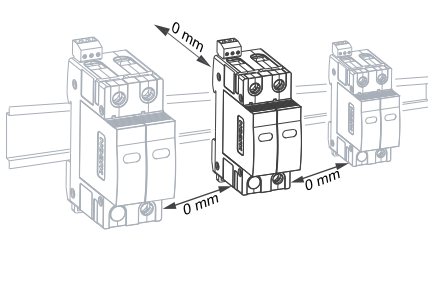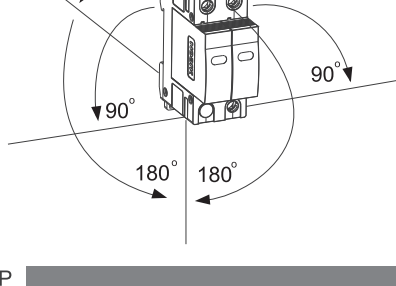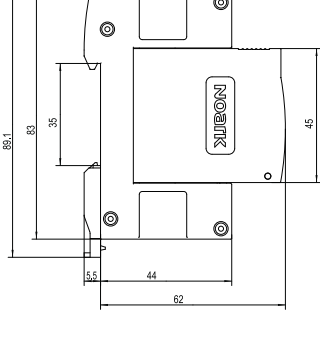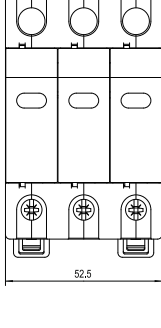

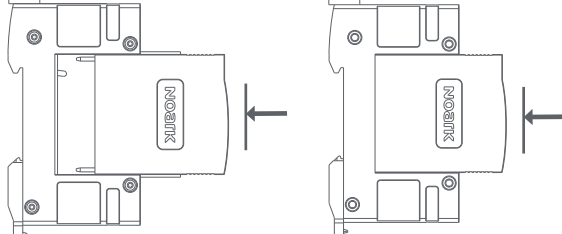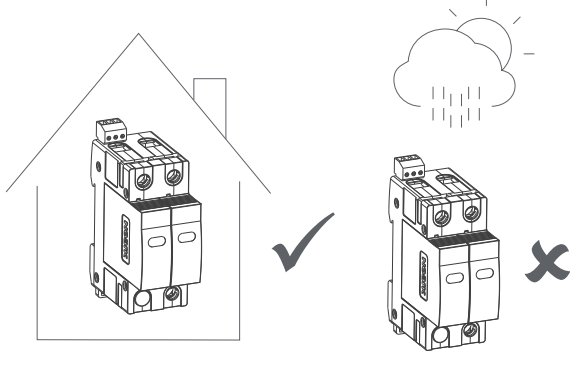


(mm ²)	2.5-25mm ²
(Nm)	2-3.5Nm

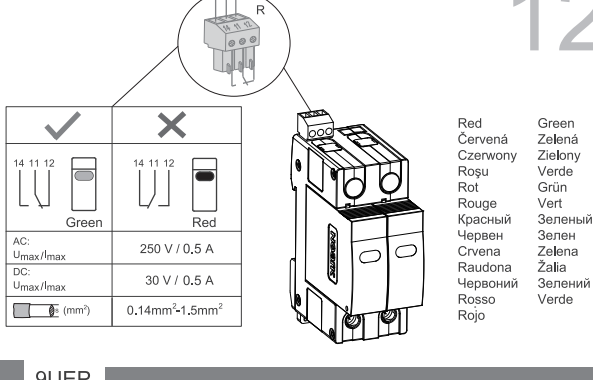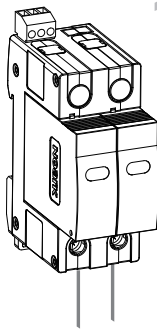


Ex9UEP 20 1P 600
Ex9UEP 20R 1P 600





Ex9UEP 20 2P 600
Ex9UEP 20R 2P 600




Ex9UEP 20 2P 1200
Ex9UEP 20R 2P 1200




Ex9UEP 20 3P 1200
Ex9UEP 20R 3P 1200




Ex9UEP 20 1P 600
Ex9UEP 20R 1P 600



Ex9UEP 20 2P 600
Ex9UEP 20R 2P 600

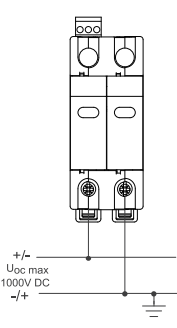

Ex9UEP 20 2P 1200
Ex9UEP 20R 2P 1200

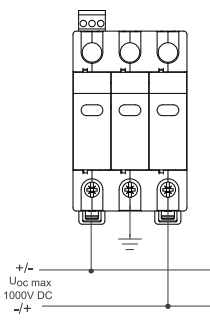

Ex9UEP 20 3P 1200
Ex9UEP 20R 3P 1200

	Ex9UEP 20 1P 600			Ex9UEP 20 2P 600			Ex9UEP 20 2P 1200			Ex9UEP 20 3P 1200		
	+ → PE	- → PE	+ → -	+ → PE	- → PE	+ → -	+ → PE	- → PE	+ → -	+ → PE	- → PE	+ → -
IEC / EN	EN 50539-11											
SPD	T2											
U _{CPV}	V _{dc}	600	600	600	600	600	1200	1200	1200	1200	1200	1200
I _n (8/20 μs)	kA	20	20	20	20	20	20	20	20	20	20	20
I _{max} (8/20 μs)	kA	40	40	40	40	40	40	40	40	40	40	40
I _{total} (8/20 μs)	kA	---	---	---	40	40	40	40	40	40	40	40
U _p @ I _n	kV	2.3	2.3	2.3	2.3	2.3	4.2	4.2	4.2	4.2	4.2	4.2
I _{scpv}	A	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
I _{pe} @ U _{REF} AC	< 1mA											
I _{pe} @ U _{REF} DC	< 50μA											
OCM		✓			✓			✓			✓	
SCM		×			×			×			×	
T _{amb}	-40—+80°C											
RH	5%~95%											

